


Copy of the certificate regarding Water, Health & Sanitation issued by Water
Works Superintendent, Porbandar Chhaya Nagarpalika

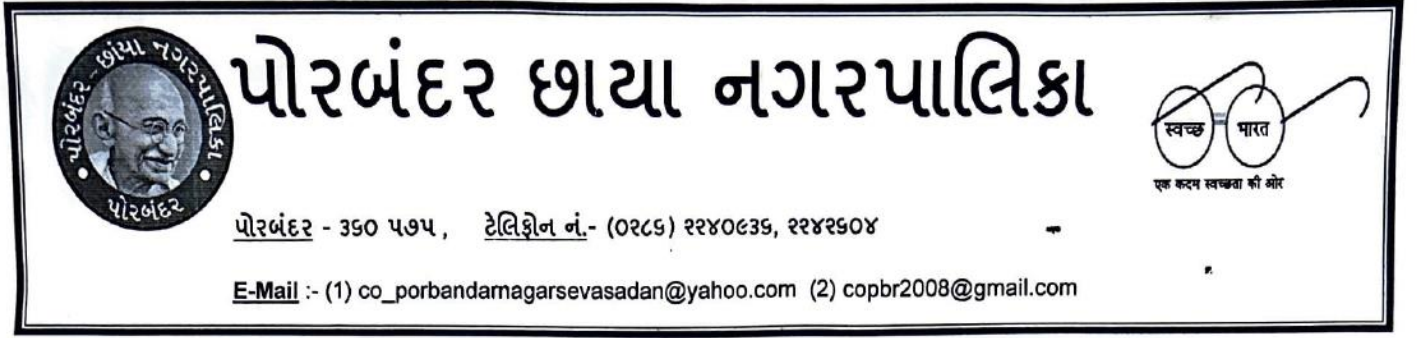


SAFE DRINKING WATER AND SANITARY CONDITION
CERTIFICATE

Date: 21-09-2024

It is certified that The Mount Litera Zee School Porbandar, located at behind Sandipani Aashram Porbandar has safe drinking water facilities for the student and members of staff of the institution and is maintaining the hygienic sanitation condition in the school building & in the campus as per the norms prescribed by the State Govt.


The above valid for a period of two years


Water Works Supritendent
Porbandar Chhaya Nagarpalika

TO
THE MOUNT LITERA ZEE SCHOOL PORBANDAR,
BEHIND SANDIPANI AASHRAM,
PORBANDAR

FRIENDS DREAM EDUCATION TRUST


TRUSTEE


PRINCIPAL
MOUNT LITERA ZEE SCHOOL
PORBANDAR

Copy of the Water Examination Report



Making
Analyte
Count

Page 1 of 1

TEST REPORT					
Report No: ECL/WAC/1011/24-25					
Issued to	Mount Litera Zee School Porbandar Behind Sandipani Ashram, Porbandar - 360577.				
Sample collected By	ECL Team Member (Mr. Nimesh)				
Sample Identity	Water	Test Report as per	IS : 10500:2012		
Sample Description	Drinking Water	Batch No.	----		
Quantity	1000 mL Approx.	Brand Name	----		
Date of Sampling	15/03/2025	Date of Mfg.	----		
Date of Receipt	Date of Start Analysis	Date of Completion	Date of Issue		
15/03/2025	16/03/2025	18/03/2025	18/03/2025		
Organoleptic and Physical Parameters					
Sr No.	TESTS	REFERENCE	UNIT OF MEASUREMENT	REQUIREMENTS	RESULTS
1.	Color	IS : 3025 (Part-04) - 2021	Hazen	5 Max.	BDL (DL=1)
2.	Odour	IS : 3025 (Part-05) - 2018	----	Agreeable	Agreeable
3.	pH Value	IS : 3025 (Part-11) - 2022	----	6.5-8.5	7.18
4.	Taste	IS : 3025 (Part-07) - 2017	----	Agreeable	Agreeable
5.	Total Dissolved Solids (TDS)	IS : 3025 (Part-16) - 1984	mg/l	500 Max.	88.2
General Parameters Concerning Substances Undesirable in Excessive Amounts					
6.	Ammonia (as total ammonia-N)	IS : 3025(Part-55) - 2003	mg/l	0.5 Max.	BDL (DL=0.1)
7.	Chloride (as Cl)	IS : 3025(Part-32) - 1988	mg/l	250 Max.	26.8
8.	Nitrate (as NO ₃)	IS : 3025(Part-34) - 1988	mg/l	45 Max.	0.9
9.	Total Alkalinity (as CaCO ₃)	IS : 3025 (Part-23) - 1986	mg/l	200 Max.	48.4
10.	Total Hardness (as CaCO ₃)	IS : 3025 (Part-21) - 2009	mg/l	200 Max.	21.6
NOTE : *BDL = Below Detectable Limit					
On Analysis of all above parameters, the submitted sample CONFIRMS to the above specifications.					
<p>1 This report, in full or in part, shall not be published, advertised, used for any legal action, unless prior permission has been secured from The Eurochem Laboratories LLP, RAJKOT.</p> <p>2 This test report is ONLY FOR THE SAMPLE TESTED.</p> <p>3 Sample drawn by us.</p>					
<p>Approved By: Mr. Jay J. Ramoliya (M.Sc. Chem.)</p> <p><i>[Signature]</i></p>			<p>Mr. Nandan Sorathiya (M.Sc. Microbiology)</p> <p><i>[Signature]</i></p>		
Authorize Signatory		SEAL		Signatory	

This is computer generated copy



+91 7999995772



info@eurochemlaboratories.com



www.eurochemlaboratories.com



Eurochem Laboratorie LLP Naval Nagar-5 Corner, Nr. Fire Brigade, Mavdi Main Road, Rajkot, Gujarat - 360004.

Every 3,000 sheets of paper cost us a tree. Let's conserve. Reuse paper whenever it's possible.

FRIENDS DREAM EDUCATION TRUST

[Signature]

TRUSTEE

[Signature]

PRINCIPAL
MOUNT LITERA ZEE SCHOOL
PORBANDAR